


A


Minimum 10 reads

all samples

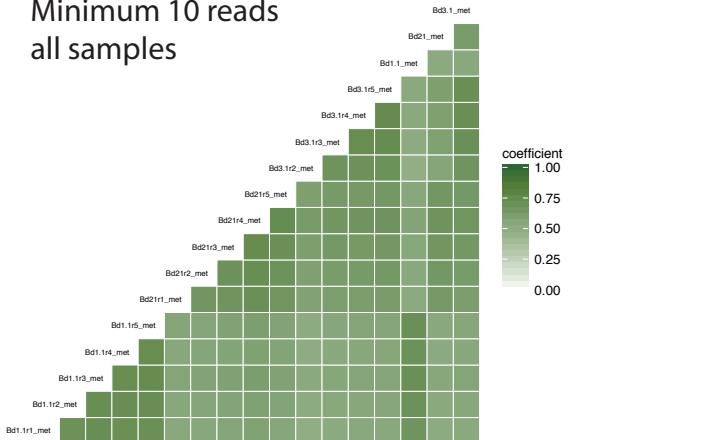


Minimum 20 reads

all samples

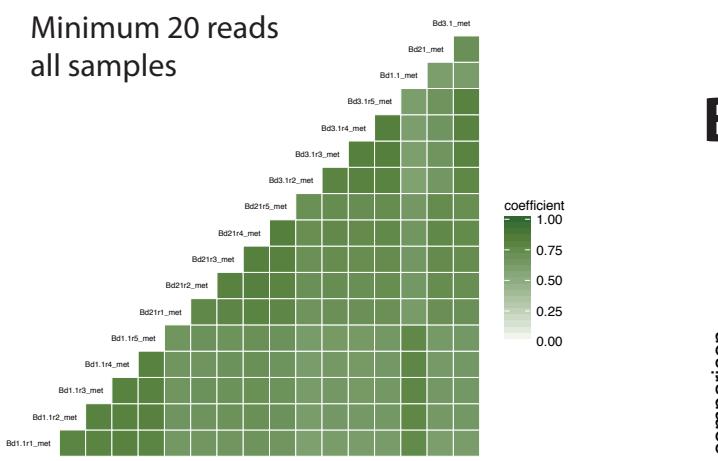



Minimum 30 reads

all samples

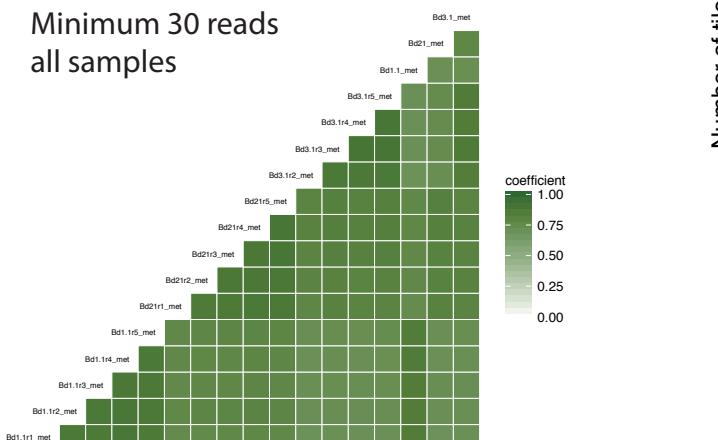

Minimum 40 reads

all samples

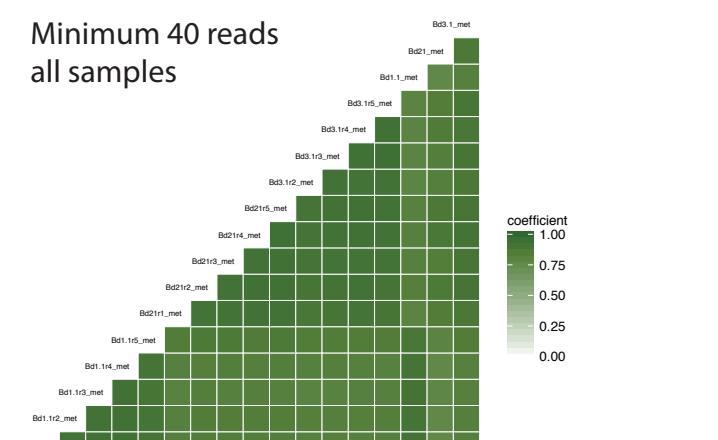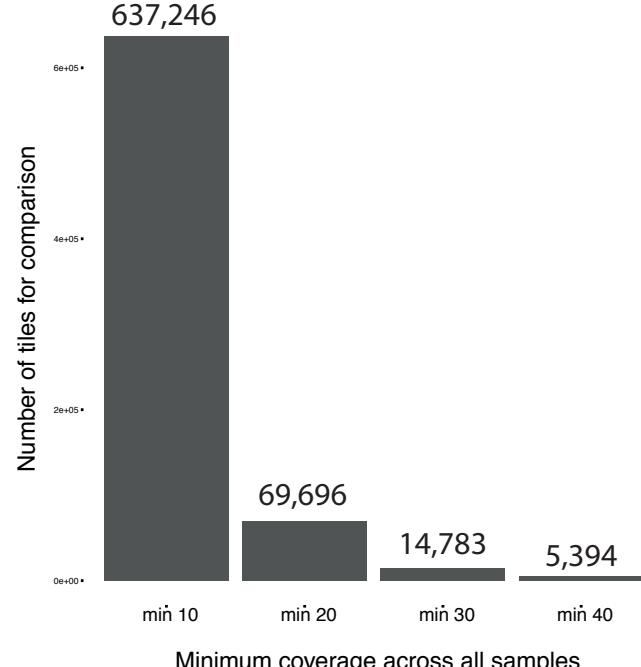**B**

Supplemental Figure 17: (A) Correlation heatmaps for CHH sites requiring various minimum read depth. **(B)** Barplot of number of sites available for analysis given minimum read depth filtering.